


1. OLWS MAY ALLOW INSIDE DROP SERVICE CONNECTIONS AT THE DISCRETION OF THE DISTRICT ENGINEER.
2. INSIDE DROPS MAY BE 4" OR 6" & SHALL BE SIZED TO MATCH THE INFLOW PIPE.
3. THE ENTRY POINT IN THE MANHOLE WALL MUST BE CORE DRILLED.
4. THE SERVICE LATERAL IS TO BE SEALED INTO THE CORED HOLE WITH A KOR-N-SEAL BOOT OR EQUIVALENT.
5. THE SERVICE LATERAL WILL COUPLE DIRECTLY TO A PVC SLIP TEE IN THE MANHOLE TO ALLOW THE DROP PIPE TO CONTACT THE MH WALL FOR ITS ENTIRE LENGTH.
6. THE DROP PIPE, 45° BEND, AND EXTENSION PIPE ARE TO HAVE GLUED JOINTS.
7. THE DROP PIPE EXTENSION MUST CONVEY SEWAGE ALL THE WAY TO THE MAIN CHANNEL.
8. THE DROP PIPE IS TO BE SECURED TO THE MANHOLE WALL BY:  
 STAINLESS STEEL STRAPS MEASURING A MINIMUM OF 1-1/2" WIDE BY 1/8" THICK;  
 STRAP SPACING WILL BE 3' ON CENTER, WITH A MINIMUM OF 2 STRAPS;  
 EACH STRAP WILL BE SECURED TO THE WALL BY A PAIR OF 5/16" STAINLESS STEEL WEDGE ANCHORS.
9. THE ANNULAR SPACE AT THE CORED HOLE IS TO BE GROUTED NEATLY AFTER ASSEMBLY.

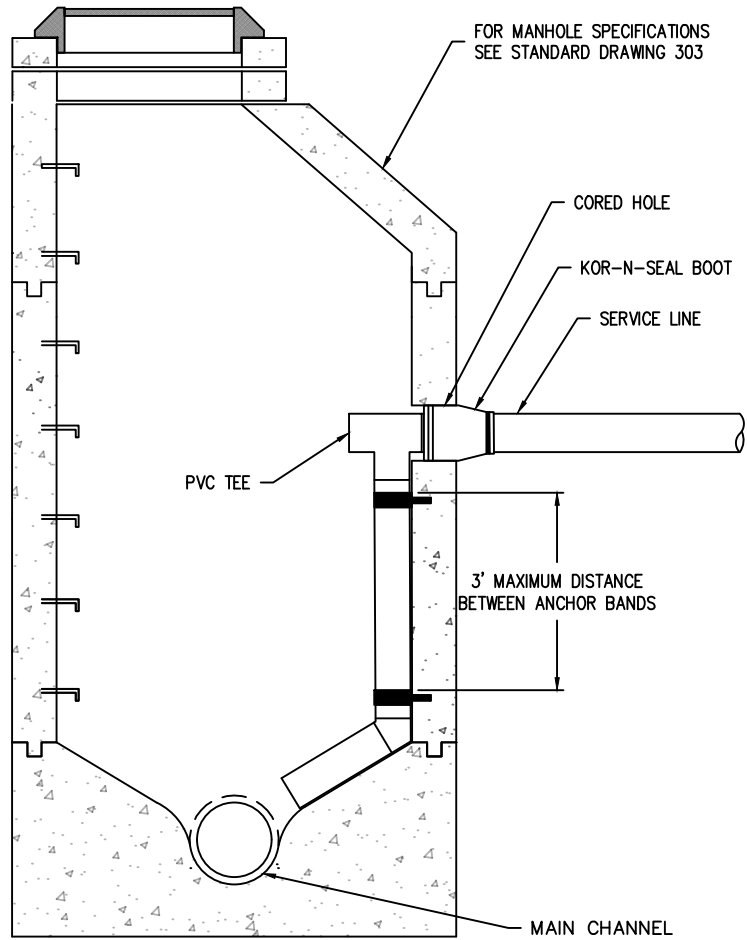

SECTION

NO.	REVISIONS	DATE	BY
1	MISC CALLOUTS	1/9/2019	HSD
2			
3			
4			